

Evidence of Performance
Hygrothermal performance of building
materials and products
Determination of water vapour transmission
properties as per DIN EN ISO 12572



Test Report 105 34243/4e


Client **ROBITEX GROUP**
Mojayskoe shosse 25

121471 Moscow
Russia

Basis
DIN EN ISO 12572 : 2001-09;
Hygrothermal performance of
building materials and products
Determination of water vapour
transmission properties

Product	Joint sealing tape
Designation	ROBIBAND VS
Order	Test according to DIN EN ISO 12572

Representation

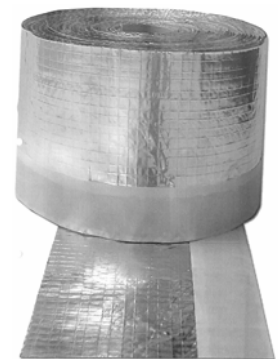

Measurements carried out in accordance with DIN EN ISO 12572 have revealed the following characteristics of ROBIBAND VS:



Water vapour resistance factor

$\mu = 275\ 008$

Water vapour diffusion-equivalent air layer thickness

$s_D = 14\ m$

Instruction for use

This test report provides evidence of the water vapour transmission properties of building materials and products

Validity

The data and results refer solely to the tested and described specimen.

Notes on publication

The ift Guidance Sheet "Conditions and Guidance for the Use of ift Test Documents" applies.

The cover sheet can be used as abstract.

Contents

The test report comprises a total 5 Pages

- 1 Object
- 2 Procedure
- 3 Detailed results
- 4 Summary

ift Rosenheim
16 March 2009

Karin Lieb, Dipl.-Ing. (FH)
Head of Testing Department
ift Centre Glass, Building Materials & Building Physics

Irina Hausstetter, Dipl.-Ing. (FH)
Test engineer
ift Centre Glass, Building Materials & Building Physics



ift Rosenheim GmbH
Geschäftsführer:
Dipl.-Ing. (FH) Ulrich Sieberath
Dr. Jochen Peichl

Theodor-Giethl-Str. 7 - 9
D-83026 Rosenheim
Tel.: +49 (0)8031/261-0
Fax: +49 (0)8031/261-290
www.ift-rosenheim.de

Sitz: 83026 Rosenheim
AG Traunstein, HRB 14763
Sparkasse Rosenheim
Kto. 3822
BLZ 711 500 00

Notified Body Nr.: 0757
Anerkannte PUZ-Stelle: BAY 18

DAP-PL-0908 99
DAP-ZE-2288 00
TGA-ZM-16-93-00
TGA-ZM-16-93-60